


# DOSING STATION 350L

## DOSITEC

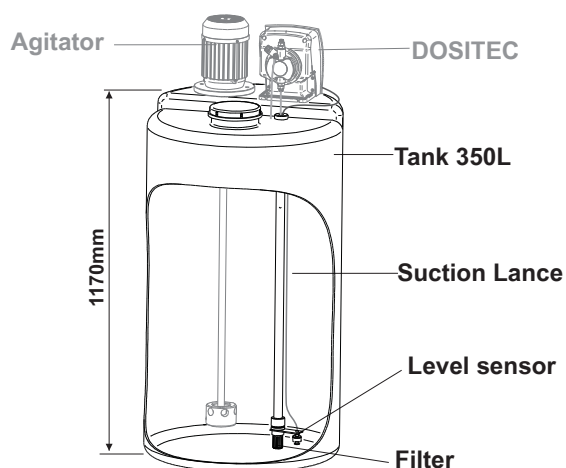


### Code formulation

8 3 - K 0 4 - R I 1150 - L N A B

<b>Filter</b>	←
R: Polypropylene filter	
I : AISI 316	
<b>Level sensor</b>	←
L: With level sensor	
N: Without level sensor	
<b>Pre-installation</b>	←
A: pre-installation Agitator and Pump	
B: pre-installation Pump	

## DOSTEC 40 (60l/h max.)

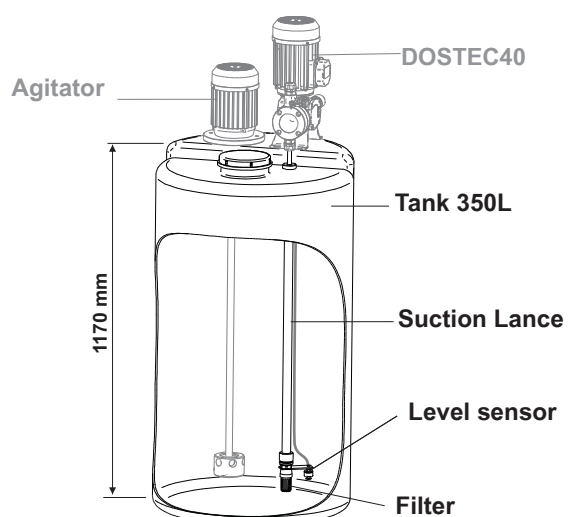


### Code formulation

8 3 - L 0 6 - R I 1150 - L N A B

<b>Filter</b>	←
R: Polypropylene filter	
I : AISI 316	
<b>Level sensor</b>	←
L: With level sensor	
N: Without level sensor	
<b>Pre-installation</b>	←
A: pre-installation Agitator and Pump	
B: pre-installation Pump	

## DOSTEC 40 (500l/h max.)

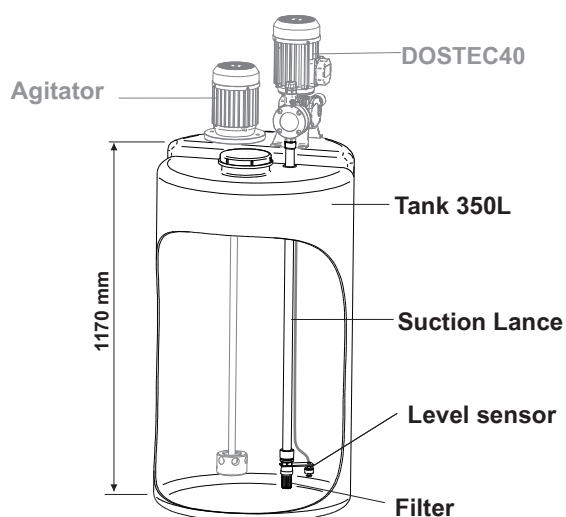

### Code formulation

8 3 - M 2 0 - P R I 1500 - L N A B

<b>Filter</b>	←
R: Polypropylene filter	
I : AISI 316	
<b>Level sensor</b>	←
L: With level sensor	
N: Without level sensor	
<b>Pre-installation</b>	←
A: pre-installation Agitator and Pump	
B: pre-installation Pump	